CABLE ROUTING LAYOUT

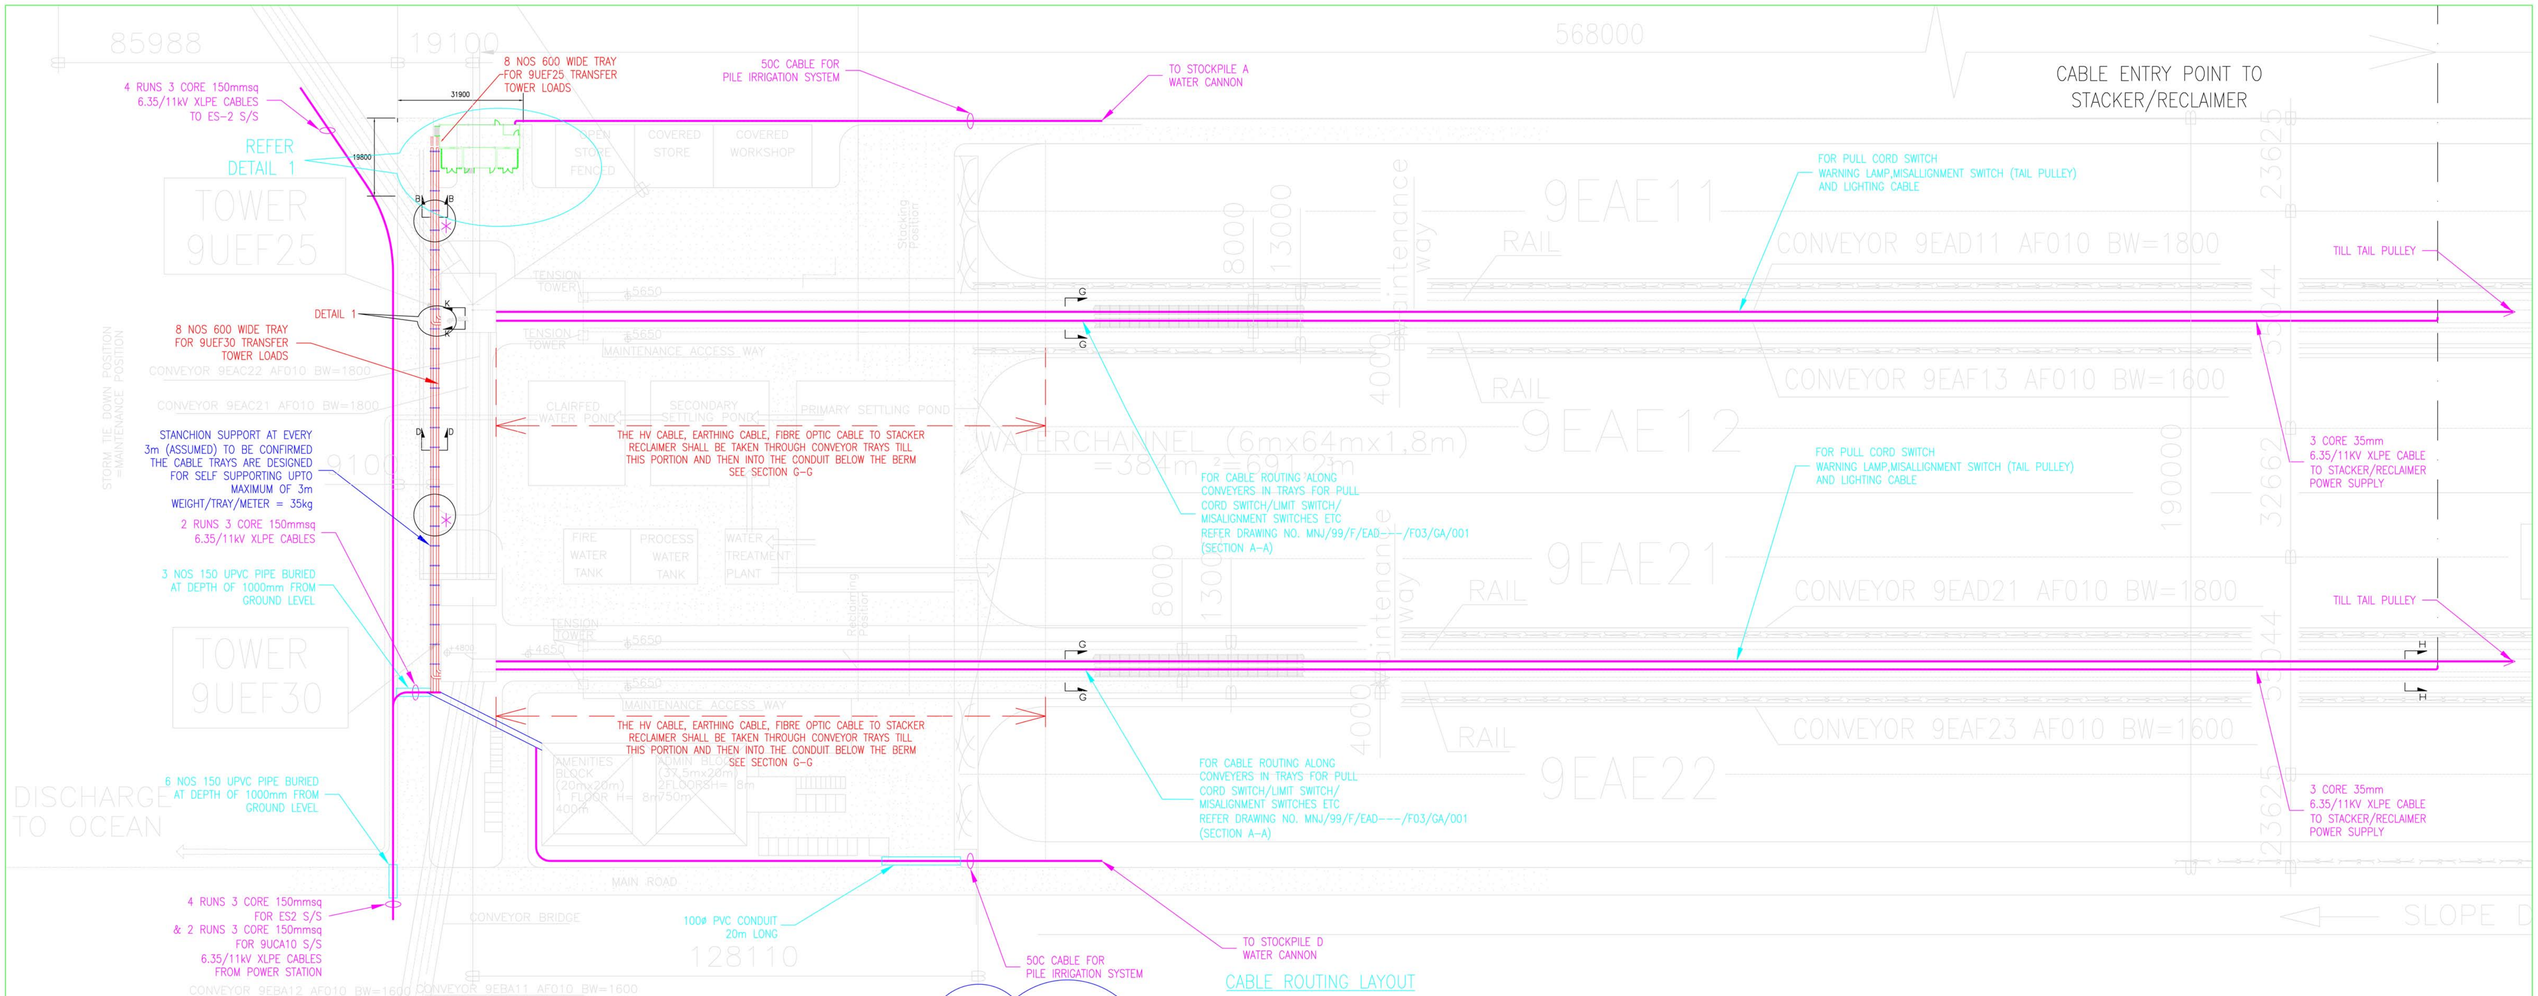

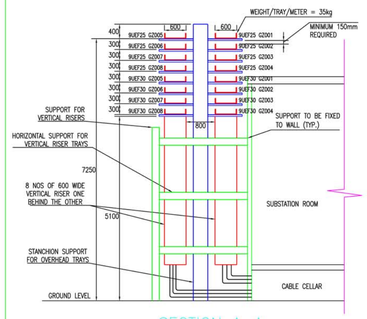

SECTION A-A
1 : 60

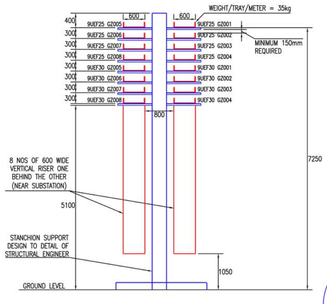

SECTION B-B
1 : 60

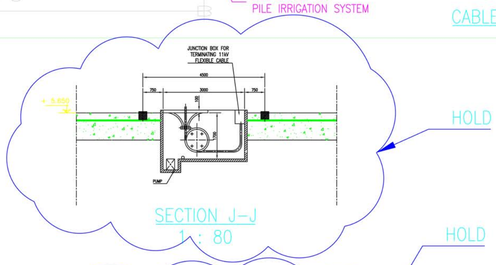

SECTION J-J
1 : 80

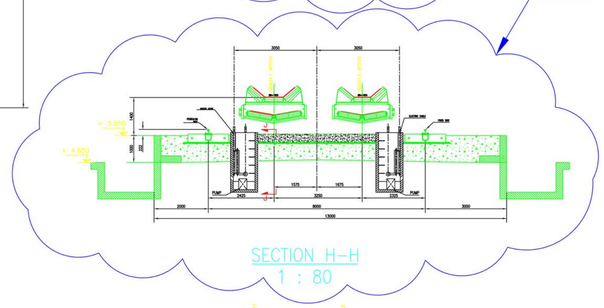

SECTION H-H
1 : 60



DETAIL 1
1 : 60



SECTION K-K
1 : 60

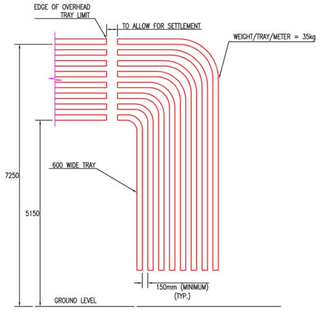

SECTION C-C
1 : 60



SECTION D-D
1 : 60

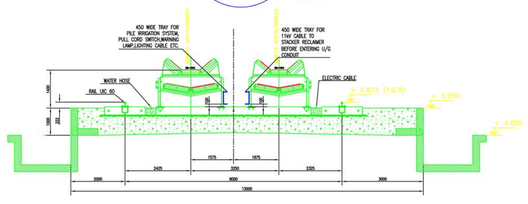

SECTION G-G
1 : 80

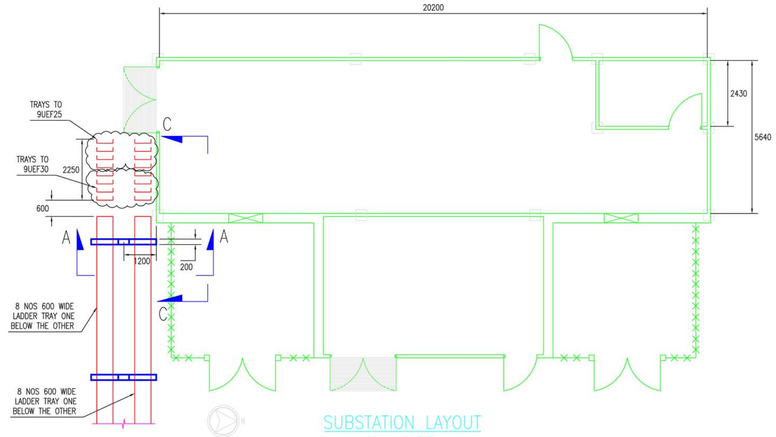

SUBSTATION LAYOUT
1 : 100

NOTE:

1) FOR PILE IRRIGATION VALVES CABLE & 11kV REELING CABLE ROUTING REFER DWG. NO. MNJ/99/F/EAD----/F03/GA/001
2) THE CABLE ENTRY TO TRANSFER TOWER SHALL BE PROVIDED WITH LOOP TO ALLOW FOR SETTLEMENT OF TOWER.
3) ✳ THE STANCHION SUPPORTS SHALL CLEAR THE ROAD.

REV.	DATE	AUTH.	CHECK BY	APPR. BY.	MODIFICATION	STATUS
A	01/03/01	SYED	SRIDHAR	V. KUMAR	FIRST ISSUE	PRE